

WATER REQUIREMENT

-AT FIELD ELEVATION
-WITHIN 100' OF FIELD
-DOWNSTREAM OF BACKFLOW IS
88 GPM @ 52 PSI

IRRIGATION LEGEND

PRODUCT DESCRIPTION

- HUNTER I-35-06-SS-XX NOZZLE AS SHOWN
- HUNTER I-35-06-SS-XX NOZZLE AS SHOWN

NOZZLE PERFORMANCE:

- #13 @ 40 PSI - 12.4 GPM 53' RADIUS
- #15 @ 40 PSI - 14.7 GPM 55' RADIUS

- ⊗ HUNTER ICV/IBV ELECTRIC CONTROL VALVE SIZED AS SHOWN
- ⊗ HUNTER HQ-44-XX-AW QUICK COUPLER VALVE (OPTIONAL)
- ⊗ HUNTER AGC-1800 SOLID STATE METAL CABINET CONTROLLER
- ⊗ HUNTER SOLAR-SYNC-SEN ON SITE WEATHER SENSOR
- ⊗ WATER METER MINIMUM SIZE @ 88 GPM IS 2.0"
- ⊗ BACKFLOW PREVENTER SIZED TO SYSTEM GPM

- MAINLINE PIPE
- LATERAL PIPE
- SLEEVE/ING
- ⊗ ISOLATION VALVE LINE SIZED

[HFS] HUNTER FLOW SENSOR IN LINE SIZED FLOW CLIK TEE "FCT"

IRRIGATION NOTES


1. SPRINKLER LOCATIONS ARE TO SCALE
2. PIPE LOCATIONS ARE DIAGRAMMATIC
3. ALL SPRINKLERS TO BE INSTALLED ON 1" SCH 80 SWING JOINTS
4. ALL COMPONENTS TO BE INSTALLED AS PER MANUFACTURERS RECOMMENDATIONS
5. MAINLINE DEPTH TO BE NO LESS THAN 18"
6. LATERAL DEPTH TO BE NO LESS THAN 16"
7. ELECTRIC CONTROL VALVES TO BE COVERED WITH 12" VALVE BOX
8. LOCATE VALVES/QCVS OUT OF HIGH TRAFFIC AREAS
9. WIRE SPLICE CONNECTIONS TO BE WATERPROOF
10. QCV TO BE LOCATED IN 10" VALVE BOX
11. ALL SLEEVES TO BE 2X PIPE RUN THROUGH THEM
12. INSTALL ALL COMPONENTS AS PER LOCAL, STATE, FEDERAL CODES
13. REFER TO HUNTER INSTALLATION DETAILS
14. REFER TO HUNTER CATALOG FOR PERFORMANCE SPECIFICATIONS
15. ADD HUNTER "FS" FOR DIRTY WATER VALVE
16. ADD HUNTER "AS" FOR PRESSURE REGULATED VALVE

VALVE ID GUIDE

A1	STATION NUMBER	ZONE	SIZE	FLOW	PR	DU	SC
A1	55	1.5"	59	.82"	.69	1.5	
A2	56	1.5"	56	.98"	.79	1.3	
A3	49	1.5"	49	.98"	.79	1.3	
A4	56	1.5"	56	.98"	.79	1.3	
A5	74	1.5"	74	.93"	.75	1.4	
A6	59	1.5"	59	1.07"	.77	1.5	
A7	59	1.5"	59	1.07"	.77	1.5	
A8	2-1"	1.5"	29	2.14"	.77	1.5	
A9	1.5"	1.5"	74	1.07"	.77	1.5	
A10	1.5"	1.5"	74	1.07"	.77	1.5	
A11	1.5"	1.5"	74	.54"	.71	1.4	
A12	1.5"	1.5"	88	.54"	.71	1.4	
A13	1.5"	1.5"	74	.54"	.71	1.4	
A14	1.5"	1.5"	74	.54"	.71	1.4	

SYSTEM PERFORMANCE DATA

A1	STATION NUMBER	ZONE	SIZE	FLOW	PR	DU	SC
A1	55	1.5"	59	.82"	.69	1.5	
A2	56	1.5"	56	.98"	.79	1.3	
A3	49	1.5"	49	.98"	.79	1.3	
A4	56	1.5"	56	.98"	.79	1.3	
A5	74	1.5"	74	.93"	.75	1.4	
A6	59	1.5"	59	1.07"	.77	1.5	
A7	59	1.5"	59	1.07"	.77	1.5	
A8	2-1"	1.5"	29	2.14"	.77	1.5	
A9	1.5"	1.5"	74	1.07"	.77	1.5	
A10	1.5"	1.5"	74	1.07"	.77	1.5	
A11	1.5"	1.5"	74	.54"	.71	1.4	
A12	1.5"	1.5"	88	.54"	.71	1.4	
A13	1.5"	1.5"	74	.54"	.71	1.4	
A14	1.5"	1.5"	74	.54"	.71	1.4	

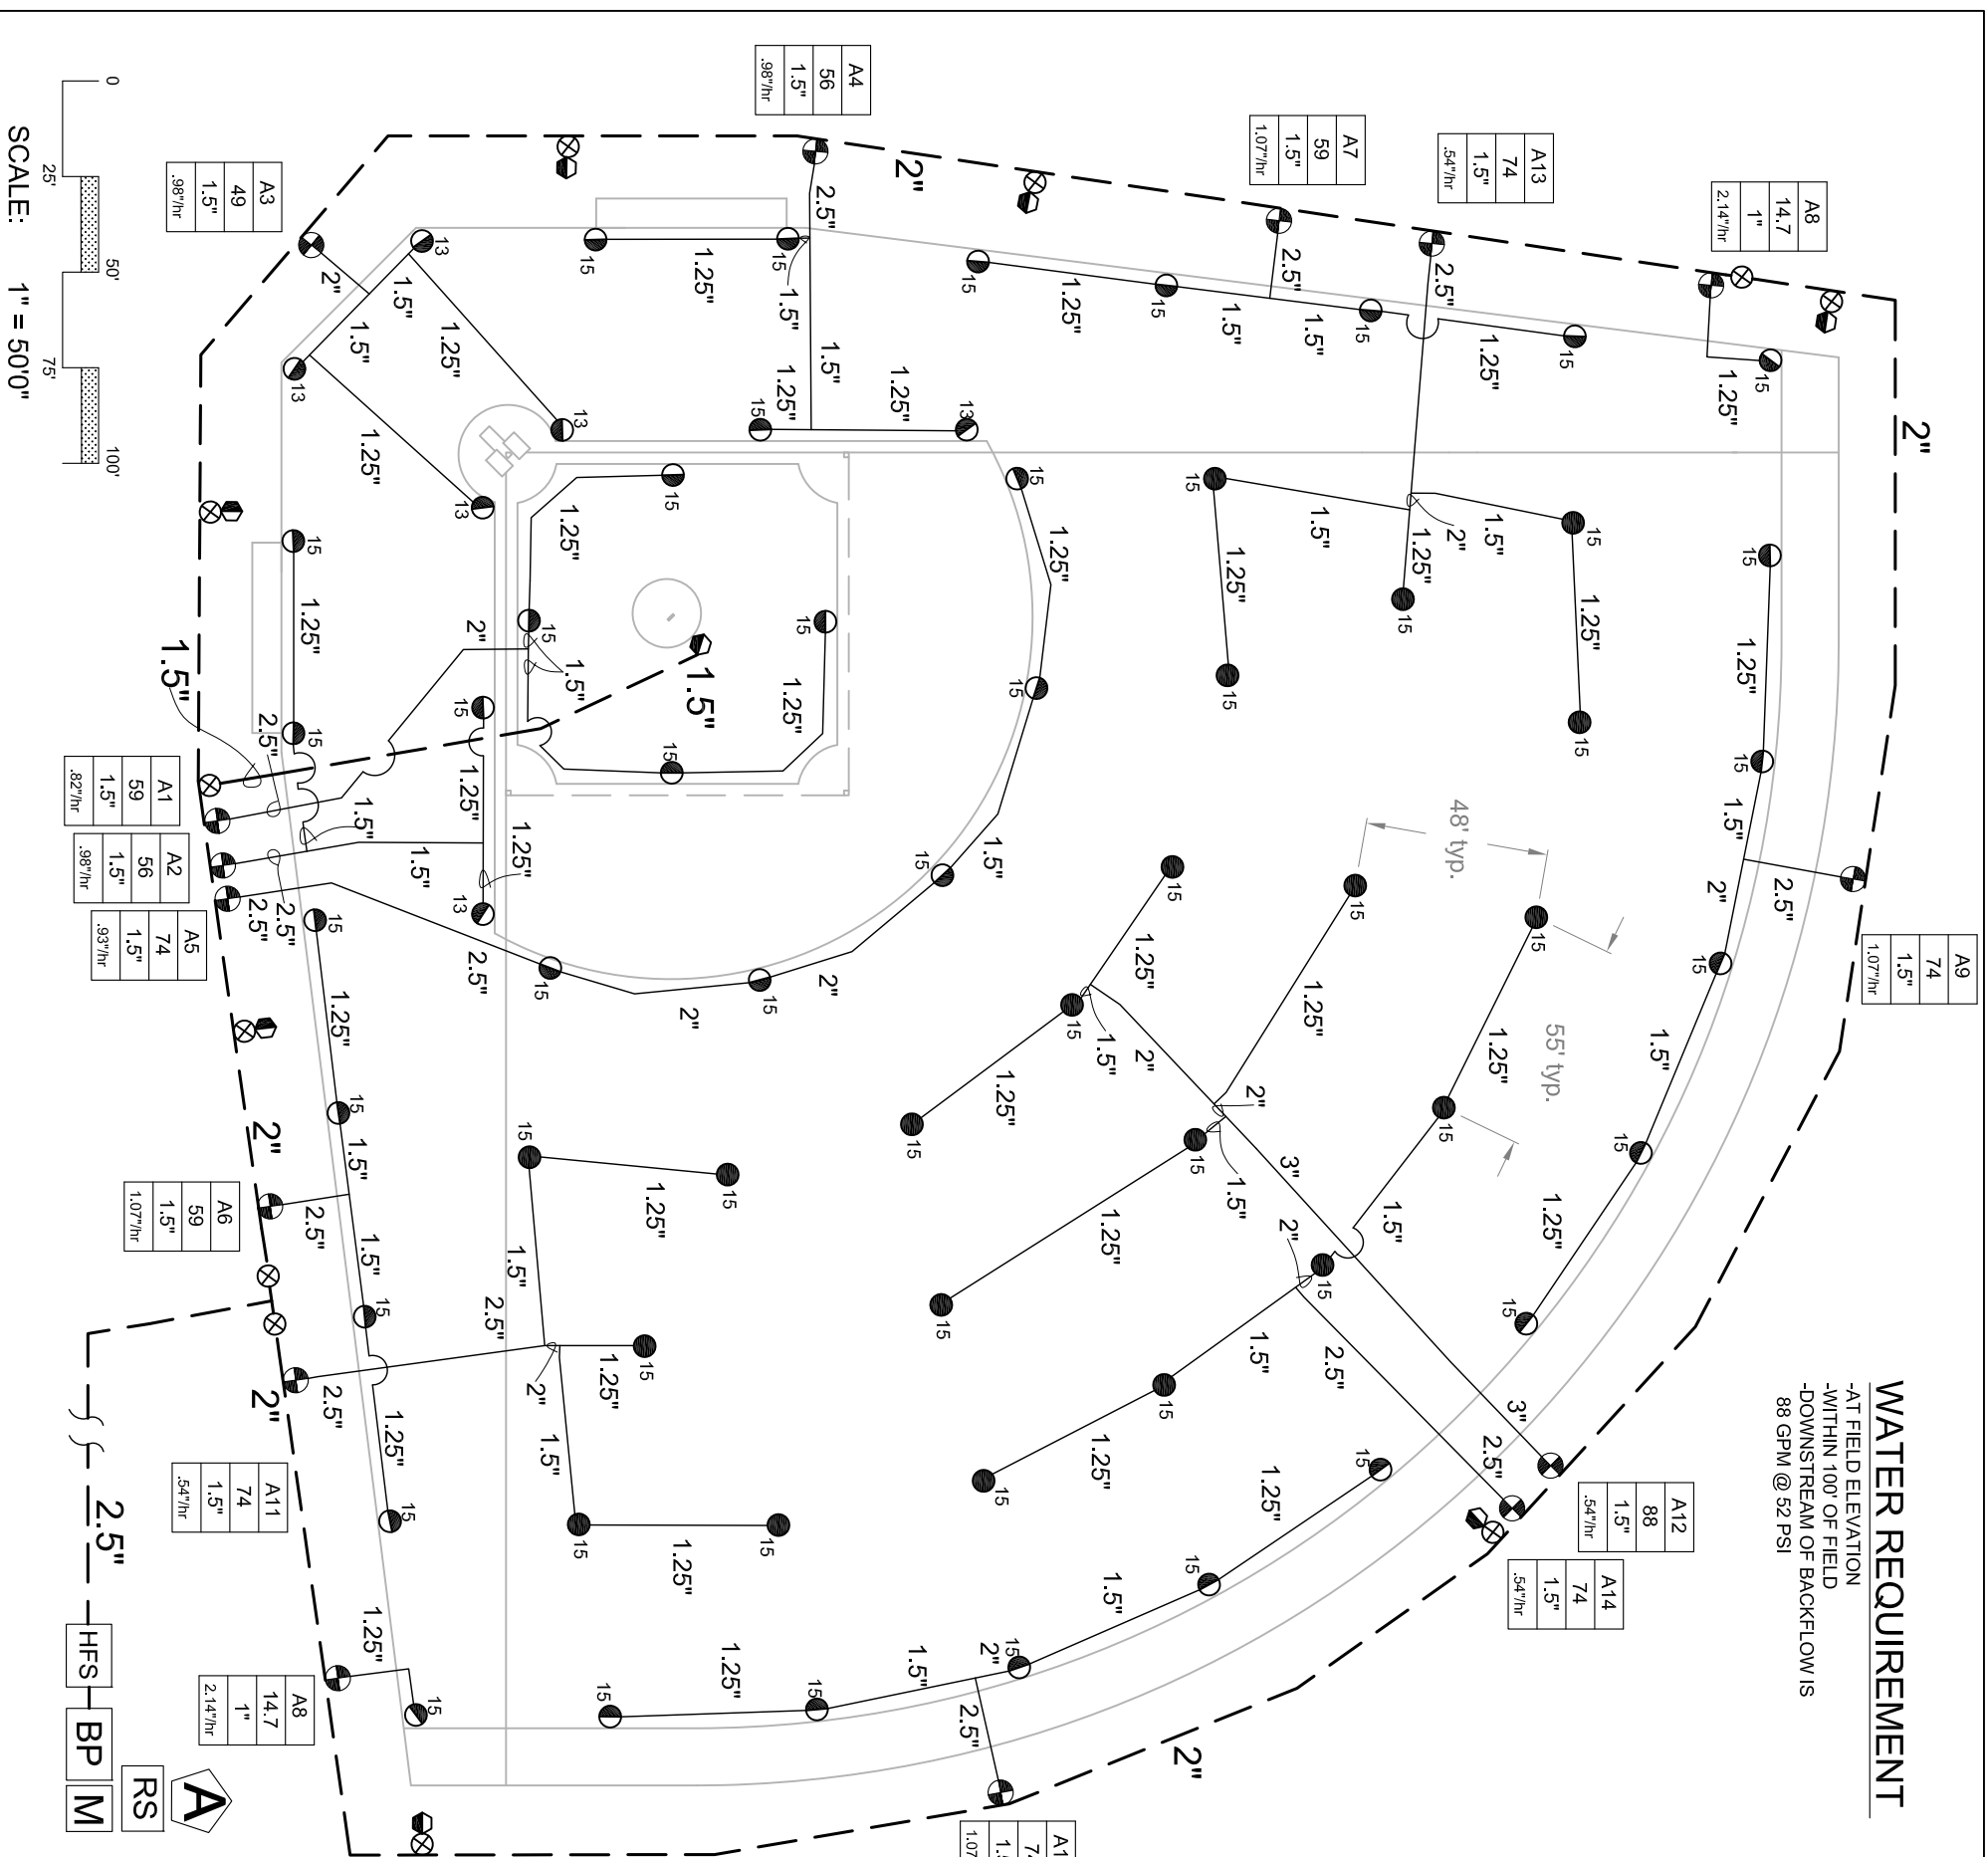

OFFICIAL BASEBALL FIELD

I-35LP FIVE ROW DESIGN
LOOPED MAINLINE



Hunter Industries
1940 Diamond Street
San Marcos, California 92078
SpecPro Technical Assistance
1-800-319-4796
www.HunterIndustries.com

SHEET

1 OF 1

Hunter Industries offers this plan as a general guide for estimating purposes and offers no indemnity, expressed or implied, for projects installed from this plan. Because of the many variables of every system and of every site we recommend that a qualified irrigation designer be consulted.