


WATER REQUIREMENT
 -AT FIELD ELEVATION
 -WITHIN 100' OF FIELD
 -DOWNSTREAM OF BACKFLOW IS 73.0 GPM @ 90 PSI

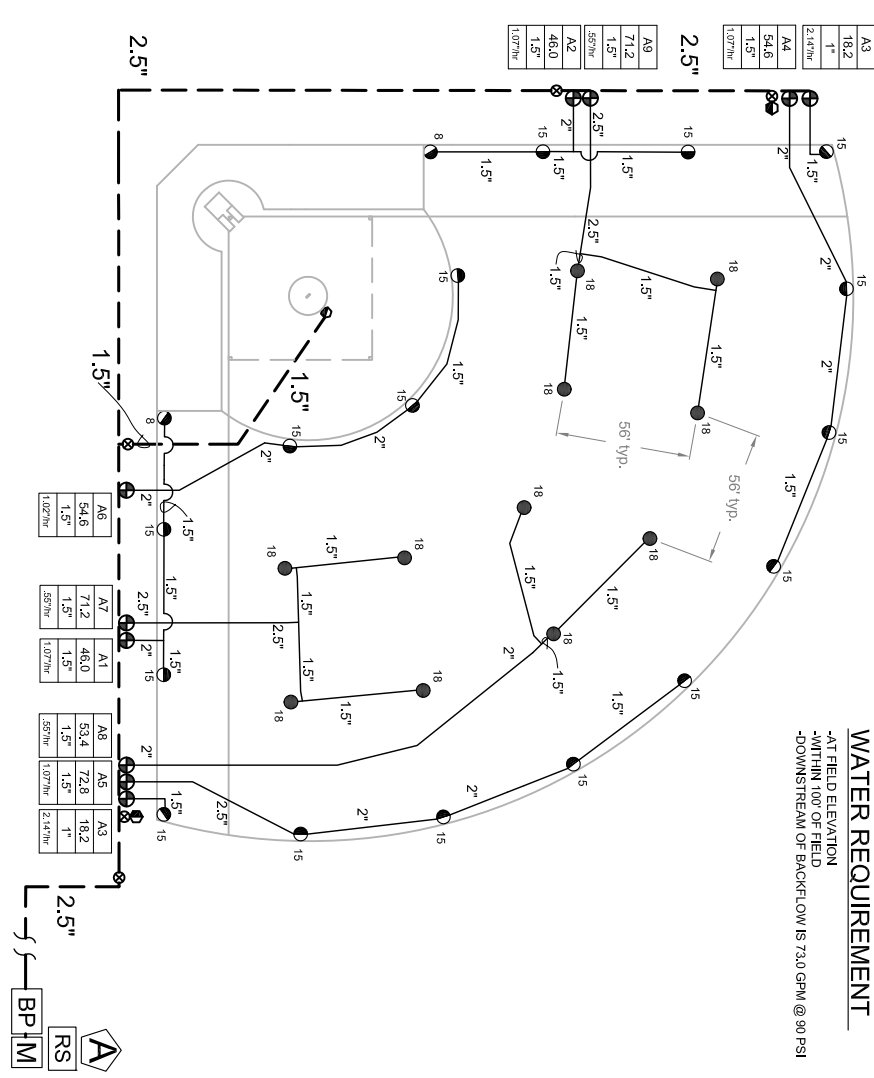

IRRIGATION LEGEND

- PRODUCT DESCRIPTION**
- HUNTER I40-04-SS-ON-XXI-I40-06-SS-ON-XX, NOZZLE AS SHOWN
 - HUNTER I40-04-SS-XXI-I40-06-SS-XX, NOZZLE AS SHOWN
- NOZZLE PERFORMANCE:**
- #8 @ 80 PSI - 9.2 GPM 46' RADIUS
 - #15 @ 80 PSI - 18.3 GPM 62' RADIUS
 - #18ON @ 80 PSI - 17.8 GPM 62' RADIUS
- ⊕ HUNTER ICV/BEV ELECTRIC CONTROL VALVE SIZE AS SHOWN
 - ⊖ HUNTER HQ44-XX-AW QUICK COUPLER VALVE (OPTIONAL)
 - ⊙ HUNTER IC-1200 SOLID STATE METAL CABINET CONTROLLER
 - ⊞ HUNTER SOLAR-SYNC-SEN ON SITE WEATHER SENSOR
 - ⊠ WATER METER MINIMUM SIZE @ 73 GPM IS 2.0"
 - ⊡ BACKFLOW PREVENTER SIZED TO SYSTEM GPM
- MAINLINE PIPE
 --- LATERAL PIPE
 = SLEEVING
 ⊗ ISOLATION VALVE LINE SIZED

IRRIGATION NOTES


1. SPRINKLER LOCATIONS ARE TO SCALE
2. PIPE LOCATIONS ARE DIAGRAMMATIC
3. ALL SPRINKLERS TO BE INSTALLED ON 1" SCH 80 SWING JOINTS
4. ALL COMPONENTS TO BE INSTALLED AS PER MANUFACTURERS RECOMMENDATIONS
5. MAINLINE DEPTH TO BE NO LESS THAN 18"
6. LATERAL DEPTH TO BE NO LESS THAN 16"
7. ELECTRIC CONTROL VALVES TO BE COVERED WITH 12" VALVE BOX
8. LOCATE VALVES/OCV'S OUT OF HIGH TRAFFIC AREAS
9. WIRE SPICE CONNECTIONS TO BE WATERPROOF
10. OCV TO BE LOCATED IN 10" VALVE BOX
11. ALL SLEEVES TO BE 2X PIPE RUN THROUGH THEM
12. INSTALL ALL COMPONENTS AS PER LOCAL, STATE, FEDERAL CODES
13. REFER TO HUNTER INSTALLATION DETAILS
14. REFER TO HUNTER CATALOG FOR PERFORMANCE SPECIFICATIONS
15. ADD HUNTER "FS" FOR DIRTY WATER VALVE
16. ADD HUNTER "AS" FOR PRESSURE REGULATED VALVE

VALVE ID GUIDE

STATION NUMBER	ZONE	SIZE	FLOW	PR	DU	SC (100' MAXIMUM)
A1	1.5"	1.5"	48.0	1.07"	.83	1.2
A2	1.5"	1.5"	48.0	1.07"	.83	1.2
A3	2-1"	1.5"	36.4	1.07"	.83	1.2
A4	1.5"	1.5"	54.6	1.07"	.83	1.2
A5	1.5"	1.5"	72.8	1.07"	.88	1.2
A6	1.5"	1.5"	54.6	1.07"	.83	1.2
A7	1.5"	1.5"	54.6	1.07"	.83	1.2
A8	1.5"	1.5"	53.4	1.07"	.83	1.2
A9	1.5"	1.5"	53.4	1.07"	.83	1.2

SYSTEM PERFORMANCE DATA

STATION NUMBER	ZONE	SIZE	FLOW	PR	DU	SC (100' MAXIMUM)
A1	1.5"	1.5"	48.0	1.07"	.83	1.2
A2	1.5"	1.5"	48.0	1.07"	.83	1.2
A3	2-1"	1.5"	36.4	1.07"	.83	1.2
A4	1.5"	1.5"	54.6	1.07"	.83	1.2
A5	1.5"	1.5"	72.8	1.07"	.88	1.2
A6	1.5"	1.5"	54.6	1.07"	.83	1.2
A7	1.5"	1.5"	54.6	1.07"	.83	1.2
A8	1.5"	1.5"	53.4	1.07"	.83	1.2
A9	1.5"	1.5"	53.4	1.07"	.83	1.2



OFFICIAL SOFTBALL FIELD
 I-40 FOUR ROW DESIGN

Hunter Industries
 1940 Diamond Street
 San Marcos, California 92078
 SpecPro Technical Assistance
 1-800-3-9-7386
 www.HunterIndustries.com

SHEET
 1 OF 1

Hunter Industries offers this plan as a general guide for estimating purposes and offers no indemnity, expressed or implied, for projects installed from this plan. Because of the many variables of every system and of every site we recommend that a qualified irrigation designer be consulted.